


ELEVATION (A 8|14)
COLS. 2 THRU 14
SCALE: 1/8" = 1'-0"




TYPICAL HORIZONTAL BAR SPLICE FOR ELEVATION (A 8|14 / 9)
NOT TO SCALE

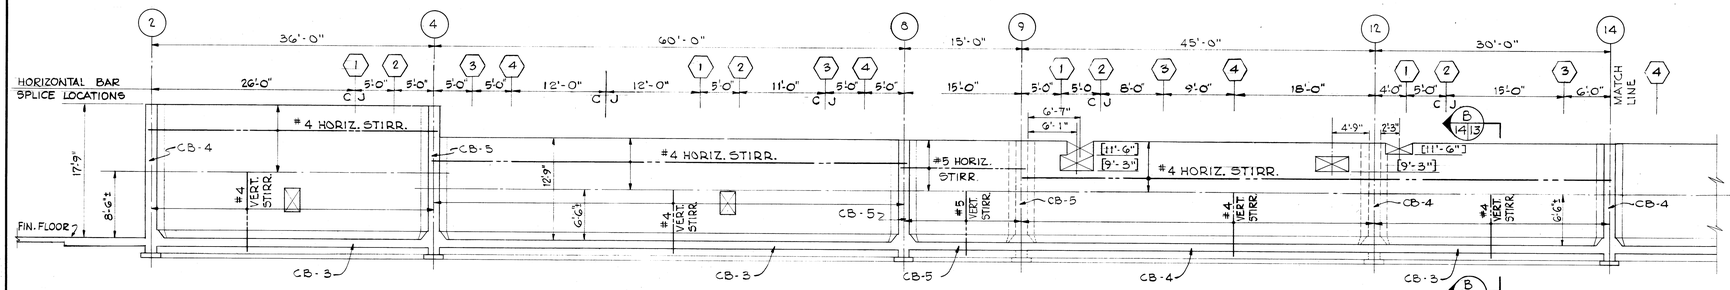


ELEVATION (A 9|14)
COLS. 14 THRU 24
SCALE: 1/8" = 1'-0"

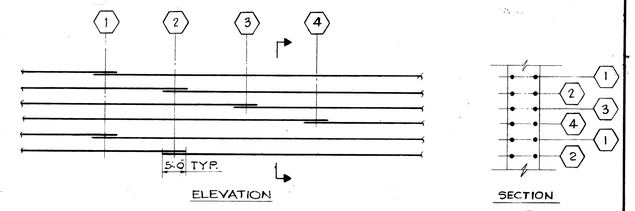


ELEVATION (B 8|14 / 9) 2

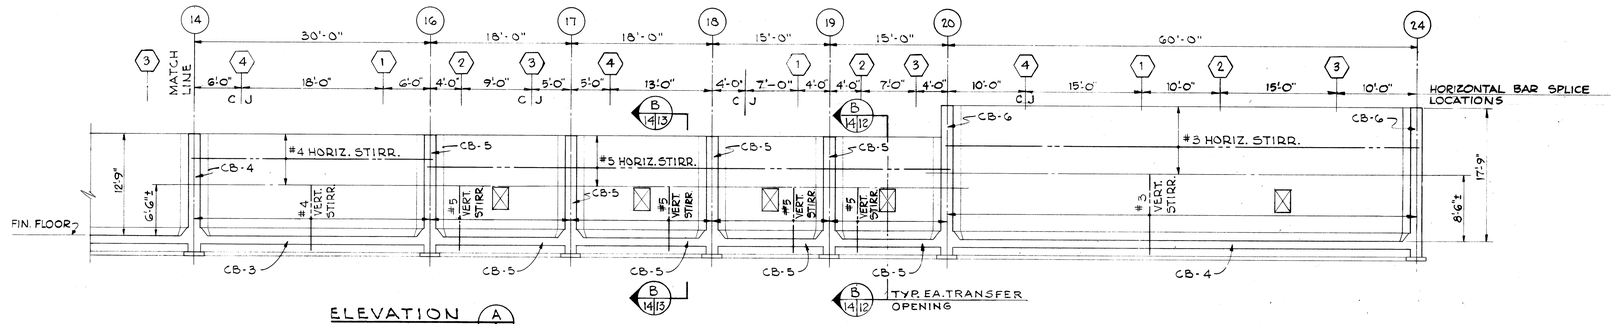


ELEVATION (C 8|14 / 9)

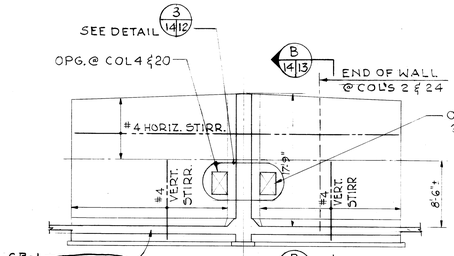


ELEVATION (D 8|14 / 9)

SIDE WALL ELEVATIONS
SCALE: 1/8" = 1'-0"

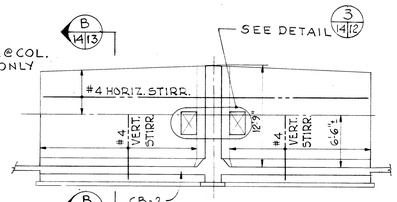


ELEVATION (E 9|14)
SEE DETAIL (1 / 14|14) FOR STIRRUPS




ELEVATION (F 8|14)
SEE DETAIL FOR STIRRUPS (1 / 14|14)

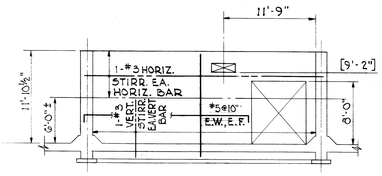


ELEVATION (G 9|14) 2

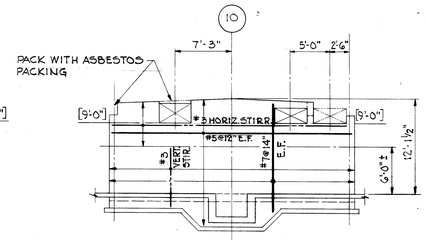


ELEVATION (H 9|14)

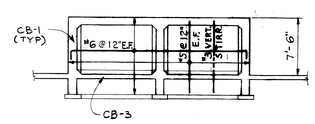


ELEVATION (J 9|14)

| CORNER BAR SCHED. | |
|---|---|
| MARK | SIZE |
| CB - 1 | #5 @ 11" |
| CB - 2 | #6 @ 11" |
| CB - 3 | #7 @ 11" |
| CB - 4 | #8 @ 11" |
| CB - 5 | #9 @ 11" |
| CB - 6 | #11 @ 11" |

SEE DETAILS (1,2,3 / 13|14) FOR PLACEMENT 2




DETAIL (1 / 14|14) 2
N.T.S.




POURING SEQUENCE 2
NOT TO SCALE

NOTE:

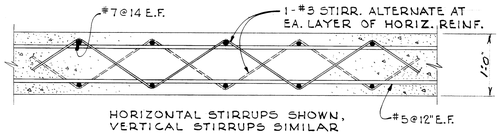THE FOLLOWING CONSTRUCTION PROCEDURE IS RECOMMENDED AND MAY BE USED AT THE CONTRACTORS OPTION:

1. POUR 6" WORKING PAD UNDER WALLS (CLASS "B" CONCRETE).
2. FABRICATE & ERECT REINFORCEMENT SHOWN ON ELEV. (A 8|9|14) & NOTE 1.
3. FABRICATE & ERECT REINFORCEMENT SHOWN ON ELEV. (B C D E 8|14 / 9), NOTE 2, & DET. 1.
4. INSERT CORNER BARS REQUIRED BY DETAILS (1 2 / 14|13)
5. INSERT ADDITIONAL BARS REQUIRED BY SECTION (B / 14|12)
6. PLACE SLAB REINFORCEMENT, SEE SHEETS 8 & 9.
7. PLACE CORNER BARS REQUIRED BY DETAIL (3 / 14|13)
8. POUR CONCRETE NOTED AS POUR NO. 1 MONOLITHIC (CLASS "Q")
9. POUR CONCRETE NOTED AS POUR NO. 2 MONOLITHIC (CLASS "Q")

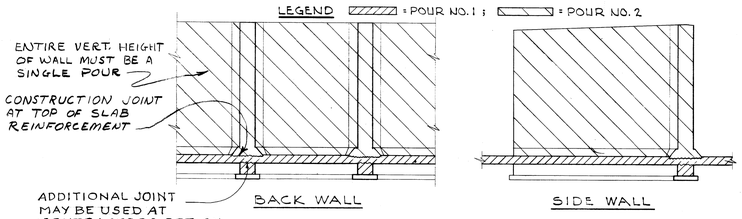GRAPHIC SCALE
1/8" = 1'-0"

2 NOTES: (CONT.)

6. STIRRUP DIAMETERS MUST BE INCREASED TWO BAR SIZES IF LACING METHOD SHOWN IN OPTIONAL SECTION B-14-13 IS USED.
7. CONSTRUCTION JOINTS MUST BE LOCATED WHERE SHOWN ON DRAWINGS.
8. CENTER WALL AND SIDE WALL THICKNESSES ARE REDUCED ABOVE MID-HEIGHT. (SEE SEC. B-14-13)
9. SEE SHEET 9 FOR TYPICAL STIRRUP BEND.

NOTES:

1. CENTER WALL (ELEV. (A / 14)) SHALL BE 2'-0" THICK WITH #11 BARS, EACH WAY, EACH FACE, @ 7" O.C. + STIRRUPS AS SHOWN.
2. SIDE WALLS (ELEVS. (B C D / 14)) SHALL BE 1'-6" THICK WITH #10 BARS, EACH WAY. EACH FACE, @ 7" O.C. + STIRRUPS AS SHOWN
3. NOTATION "CB-2" ETC. DENOTES CORNER BARS; SEE CORNER BAR SCHEDULE & DETAIL (1 2 3 / 14|13)
4. FOR SLAB REINF. SEE SHEETS 8 & 9.
5. NOTATION "CJ" DENOTES LOCATION OF CONSTRUCTION JOINTS.

| SYMBOL | DESCRIPTION | DATE | APPROVAL |
|---|---|---|---|
| 2 | REV. SEC. G-9-14, B-B-14, DET. 1-14-14, CB SCHED., & POUR SEQUENCE; ADDED NOTES 6, 7, 8, 9 | 22 Oct 66 | |
| 1 | REVISED ELEVATIONS G & J | 8/22/66 | |

REVISIONS

AMMANN & WHITNEY
CONSULTING ENGINEERS
111-8TH AVENUE, NEW YORK, N.Y.

DEPARTMENT OF THE ARMY
OFFICE OF THE CHIEF OF ENGINEERS
MILITARY CONSTRUCTION - ENGINEERING DIVISION
WASHINGTON, D.C.

DRAWN BY: F.J.W.
TRACED BY: F.J.W.
CHECKED BY:
SUBMITTED BY: AMMANN & WHITNEY
APPROVED: CHIEF N. & P.S. BRANCH
APPROVED: CHIEF, ENGINEERING DIVISION, MIL. CONSTR. O.C.E.
DATE: 15 JULY 1966
APPROVED FOR
DATE:

AMMUNITION MAINTENANCE FACILITY
# AMMUNITION MAINTENANCE BUILDING
## ELEVATIONS
## STRUCTURAL

SCALE 1/8" = 1'-0" | SPEC. NO. 16-06-324-66-CE
DRAWING NUMBER 35-69-09
SHEET 14 OF 45