CORPS OF ENGINEERS | 4 | 3 | 2 | 1 U.S. ARMY

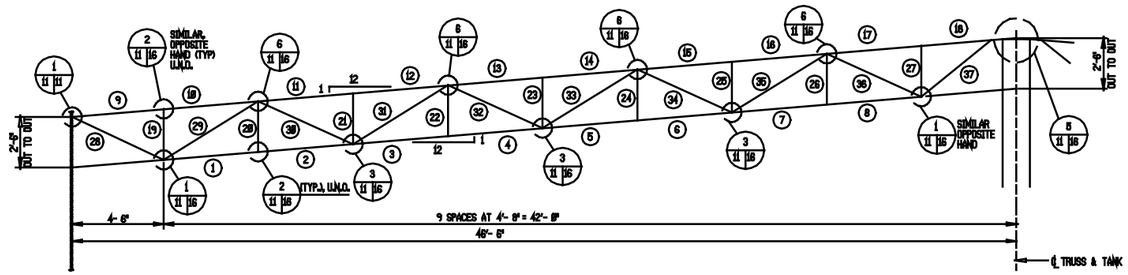

(XX) - INDICATES MEMBER DESIGNATION

ELEVATION TRUSS T-55

SCALE: 3/8" = 1'- 0"

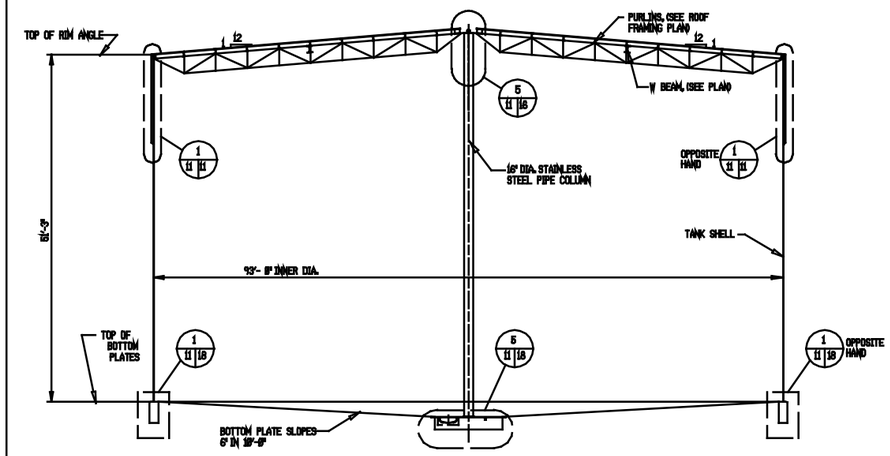

SECTION

SCALE: 1/8"=1'-0"

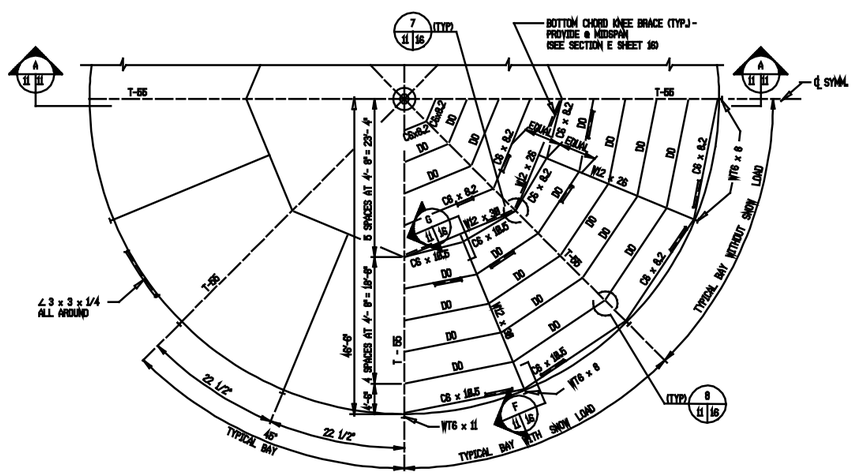

ROOF FRAMING PLAN

SCALE: 1/8" = 1'- 0"

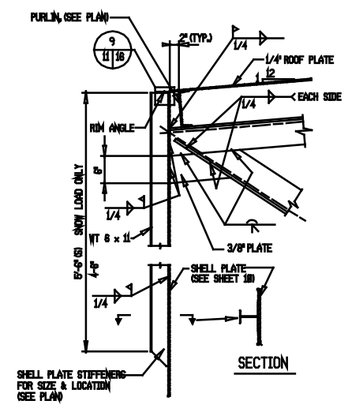

DETAIL

SCALE: 1" = 1'- 0"

STRUCTURAL STEEL NOTES:

1. BOTTOM PLATES THICKNESS SHALL BE MINIMUM 5/16", WHICH INCLUDES A CORROSION ALLOWANCE OF 1/16". THE SHELL PLATE AND ROOF PLATE THICKNESSES SHOWN INCLUDE A 1/16" CORROSION ALLOWANCE.

GRAPHIC SCALES

1/8" = 1'-0"
3/8" = 1'-0"
1" = 1'-0"
6" = 1'-0"

Symbol	Description	Date	Approved
	Revisions		

U.S. ARMY ENGINEER DIVISION, HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

Site adapt A/E:

US Army Corps of Engineers

STANDARD FUELING SYSTEMS
ABOVEGROUND VERTICAL STEEL TANKS
WITH FLOATING PANS & FIXED ROOFS

SECTIONS, DETAILS, & ROOF PLAN

(55,000 BARREL TANK)

Dwn. by: CWL | Ckd. by: SLW

Reviewed by:

Approved by:

Date: FEB 93

Drawing code: AW 78-24-27

Sheet reference number: 11

Design file no.:

Rev.

Sheet 11 of 24

5 | 4 | 3 | 2 | 1

E D C B A