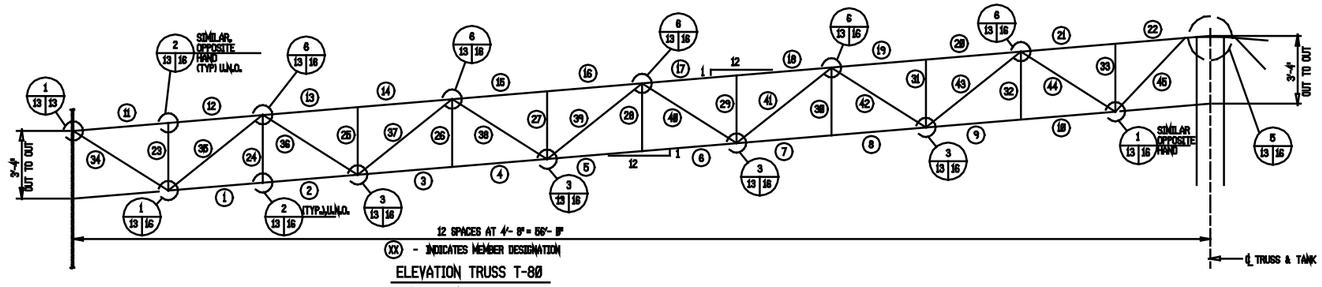

ELEVATION TRUSS T-80

SCALE: 3/8" = 1'- 8"

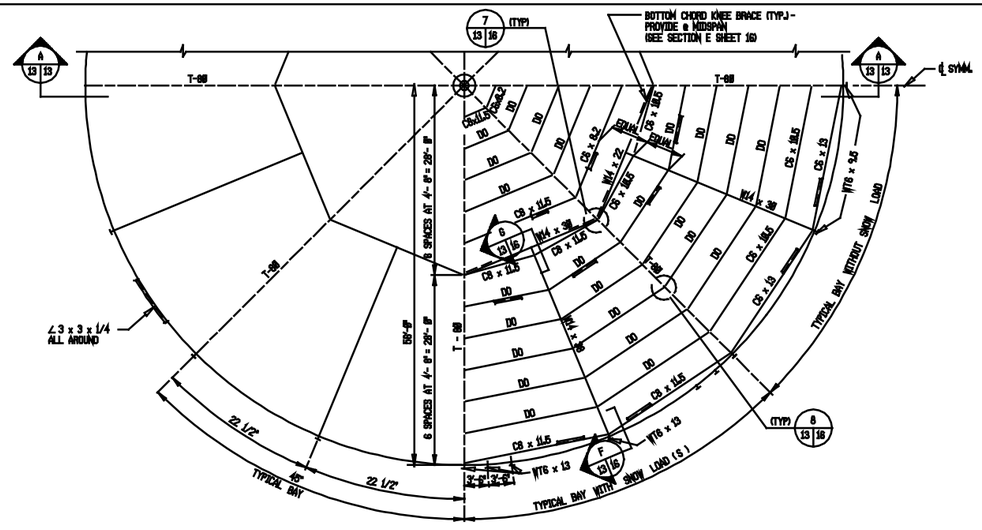

ROOF FRAMING PLAN

SCALE: 1/8" = 1'- 8"

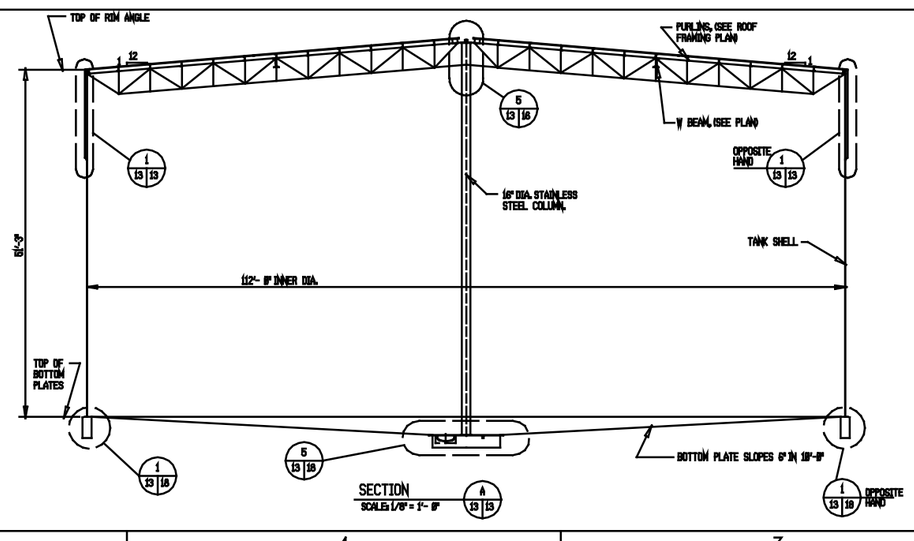

SECTION

SCALE: 1/8" = 1'- 8"

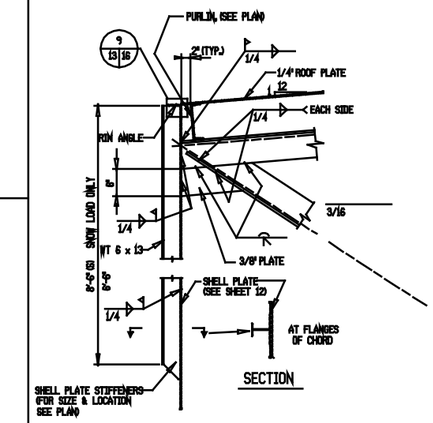

SECTION

DETAIL 1

SCALE: 1" = 1'- 8"

STRUCTRUAL STEEL NOTE:

1. BOTTOM PLATES THICKNESS SHALL BE MINIMUM 5/16", WHICH INCLUDES A CORROSION ALLOWANCE OF 1/16". THE SHELL PLATE AND ROOF PLATE THICKNESSES SHOWN INCLUDE A 1/16" CORROSION ALLOWANCE.

GRAPHIC SCALES

1/8" = 1'-8"

3/8" = 1'-8"

1" = 1'-8"

6" = 1'-8"

Symbol	Description	Date	Approved
	Revisions		

U.S. ARMY ENGINEER DIVISION, HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

Site adapt A/E :

US Army Corps of Engineers

STANDARD FUELING SYSTEMS
ABOVEGROUND VERTICAL STEEL TANKS
WITH FLOATING PANS & FIXED ROOFS

SECTIONS, DETAILS, & ROOF PLAN

(80,000 BARREL TANK)

Dwn. by: CWL | Ckd. by: SLW

Reviewed by :

Approved by :

Date : FEB 93

Drawing code : AW 78-24-27

Sheet reference number : 13

Design file no.:

Rev.

Sheet 13 of 24