CORPS OF ENGINEERS | 4 | 3 | 2 | 1 U.S. ARMY

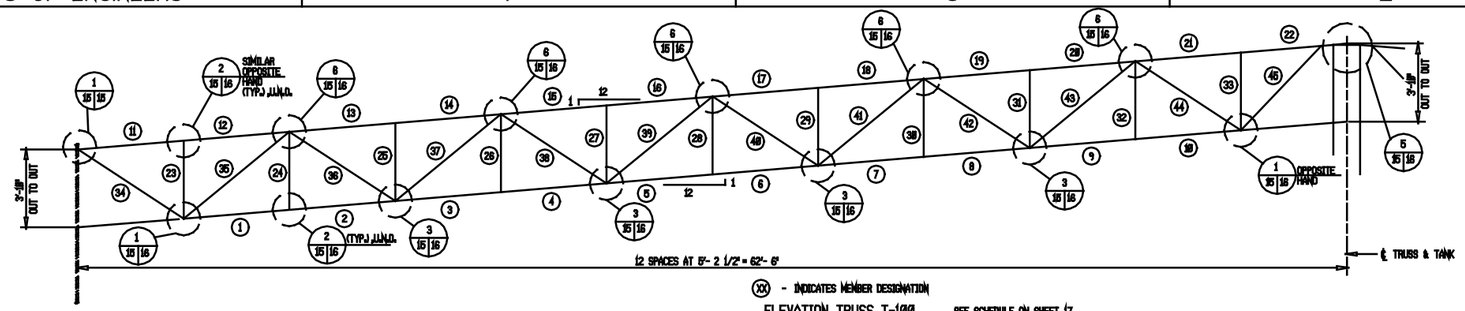

ELEVATION TRUSS T-100

SCALE: 3/8" = 1'- 0"

SEE SCHEDULE ON SHEET 17

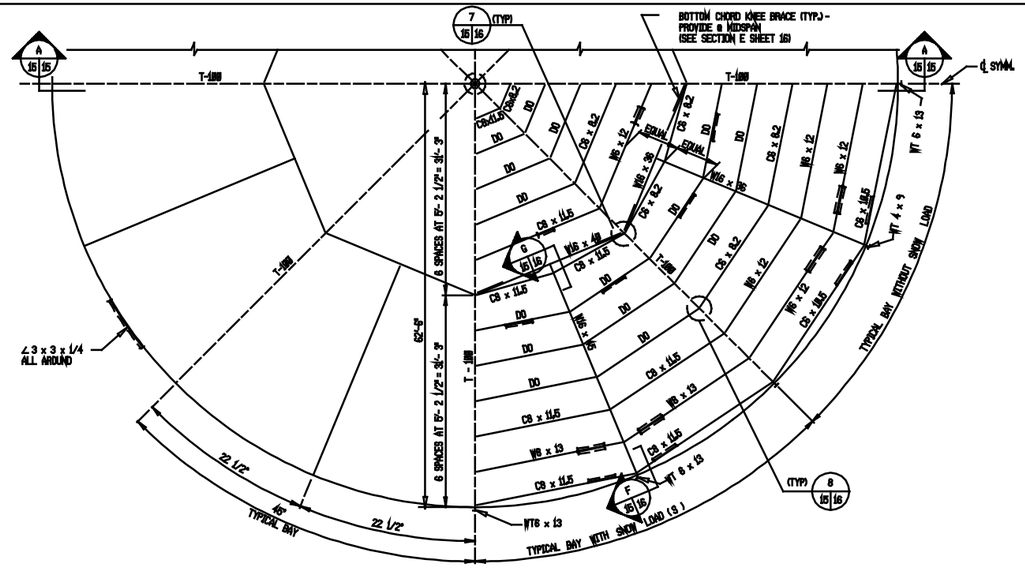

ROOF FRAMING PLAN

SCALE: 1/8" = 1'- 0"

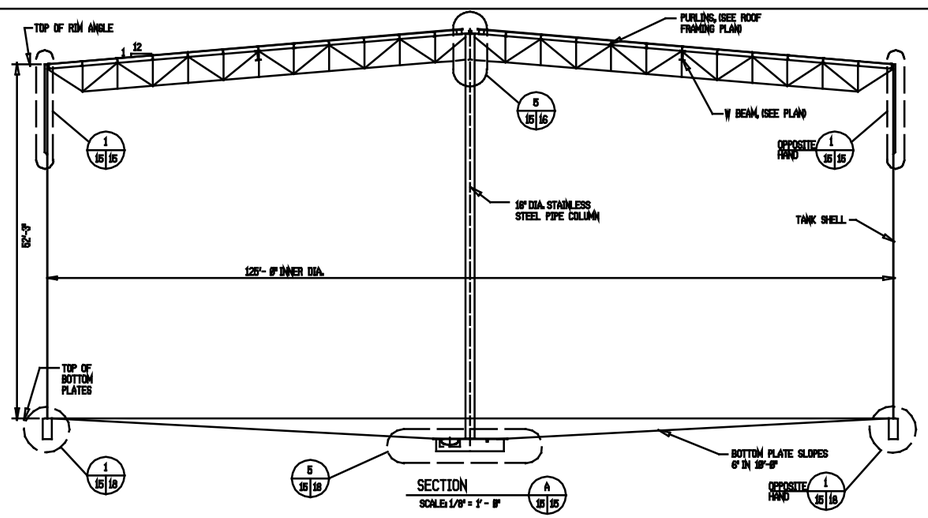

SECTION

SCALE: 1/8" = 1'- 0"

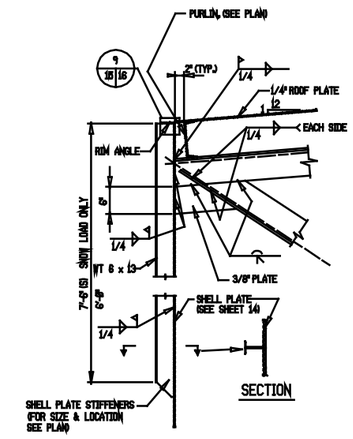

DETAIL 1

SCALE: 1" = 1'- 0"

STRUCTRUAL STEEL NOTE:

1. BOTTOM PLATES THICKNESS SHALL BE MINIMUM 5/16", WHICH INCLUDES A CORROSION ALLOWANCE OF 1/16". THE SHELL PLATE AND ROOF PLATE THICKNESSES SHOWN INCLUDE A 1/16" CORROSION ALLOWANCE.

GRAPHIC SCALES



Symbol	Description	Date	Approved
	Revisions		

U.S. ARMY ENGINEER DIVISION, HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

Site adapt A/E :

US Army Corps of Engineers

STANDARD FUELING SYSTEMS
ABOVEGROUND VERTICAL STEEL TANKS
WITH FLOATING PANS & FIXED ROOFS

SECTIONS, DETAILS, & ROOF PLAN

(100,000 BARREL TANK)

Dwn. by: CWL	Ckd. by: SLW		
Reviewed by :	Date : FEB 93	Sheet reference number : 15	Design file no.:
Approved by :	Drawing code : AW 78-24-27		Rev.
			Sheet 15 of 24

5 | 4 | 3 | 2 | 1

E D C B A