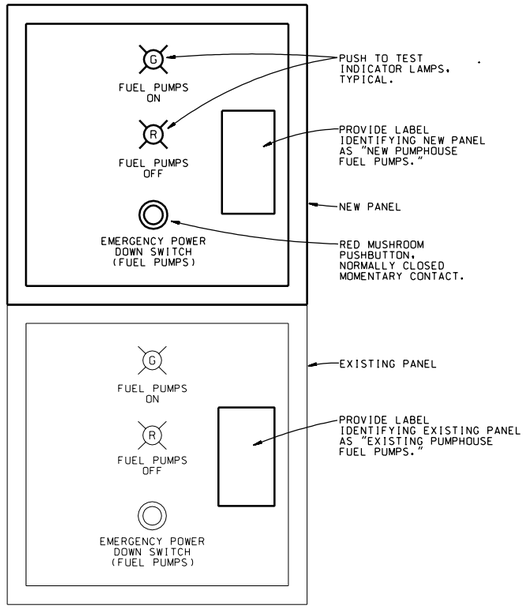

REMOTE FUEL PUMP ANNUNCIATOR PANEL

NO SCALE

NOTES TO DESIGNER

1. PLACE THE APPROPRIATE FCC INFORMATION ON THIS SHEET.

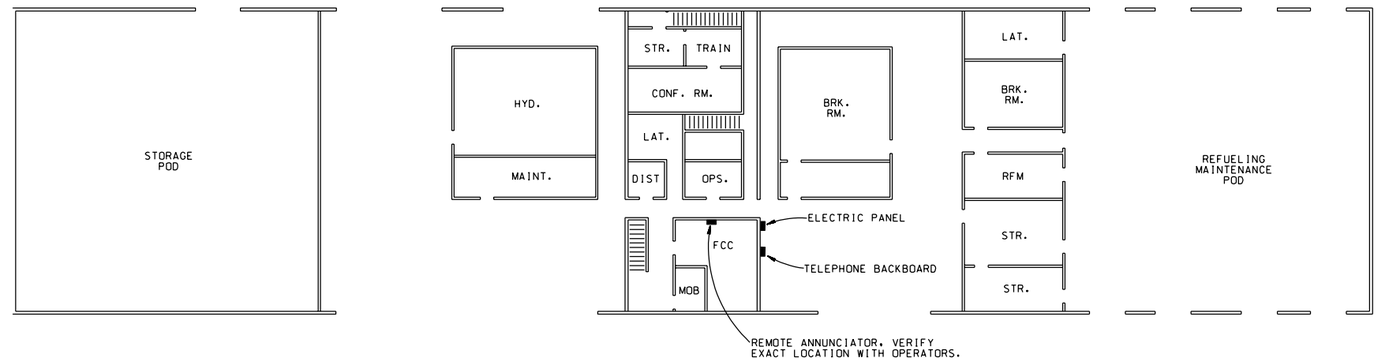

TYPICAL EXISTING FUELS CONTROL CENTER (FCC) BLDG. FLOOR PLAN

SCALE: 1/16 INCH = 1 FOOT
12'0 10' 20' 30'

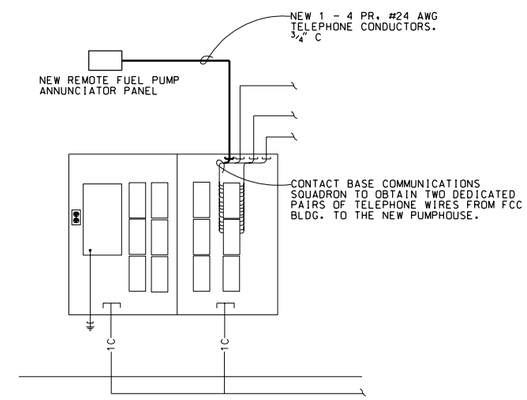

TYPICAL EXISTING (FCC) TELEPHONE BACKBOARD

NO SCALE

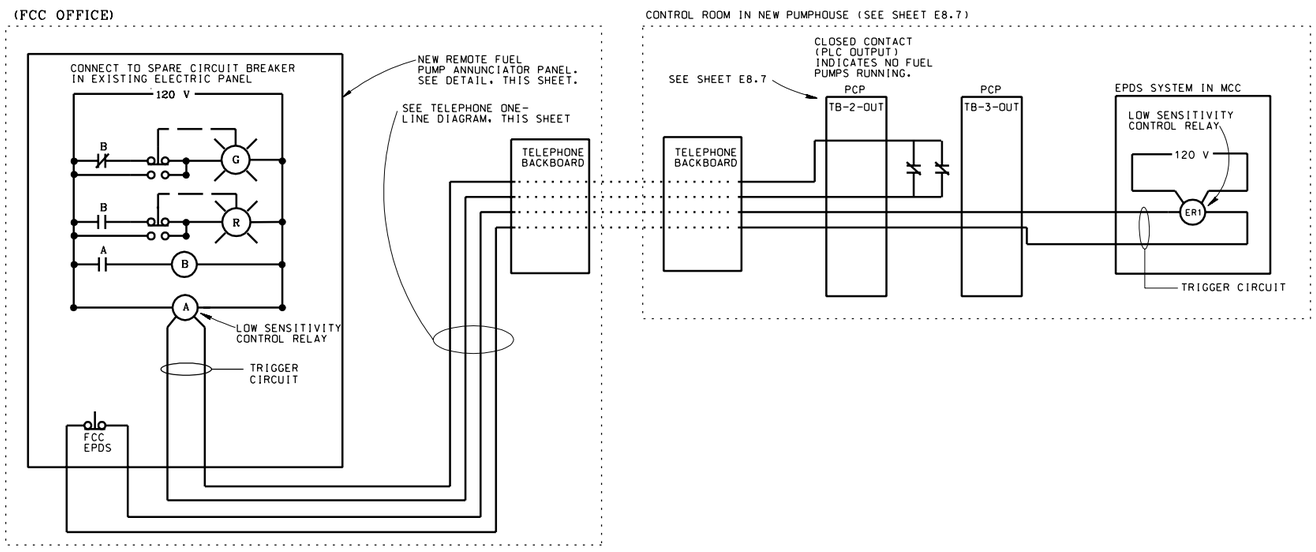

FCC OFFICE/CONTROL ROOM REMOTE EPDS SCHEMATIC

NO SCALE

$$ - THINK VALUE ENGINEERING - $$

REVISIONS

SYMBOL	DESCRIPTIONS	DATE	APPROVED

ROBERT AND COMPANY
96 POPLAR ST., N.W.
ATLANTA, GA 30335

US ARMY ENGINEER DISTRICT
CORPS OF ENGINEERS
OMAHA, NE

AIR FORCE C.E. SUPPORT AGENCY
139 BARNES DRIVE, SUITE #1
TYNDALL AFB, FL 32403-5319

DESIGNED BY: KEA
DRAWN BY: KEA
CHECKED BY: KKT
REVIEWED BY: RJB
SUBMITTED BY:
CHIEF, ELEC SECTION

AIR FORCE STANDARDS
PRESSURIZED HYDRANT FUELING SYSTEM
TYPE III

EPDS CONTROL AT FCC

PLOT SCALE RATIO: 1:1
DESIGN FILE: SD18E702.DGN
DATE: REV. #1 NOV. 1998
SPEC. NO.: 78-24-28-88 AS SHOWN
DRAWING CODE: AW 78-24-28
SHEET REFERENCE NUMBER: E7.2

COMPUTER AIDED DESIGN & DRAFTING

SD18E702.DGN 11/18/2002 09:49:47 AM