
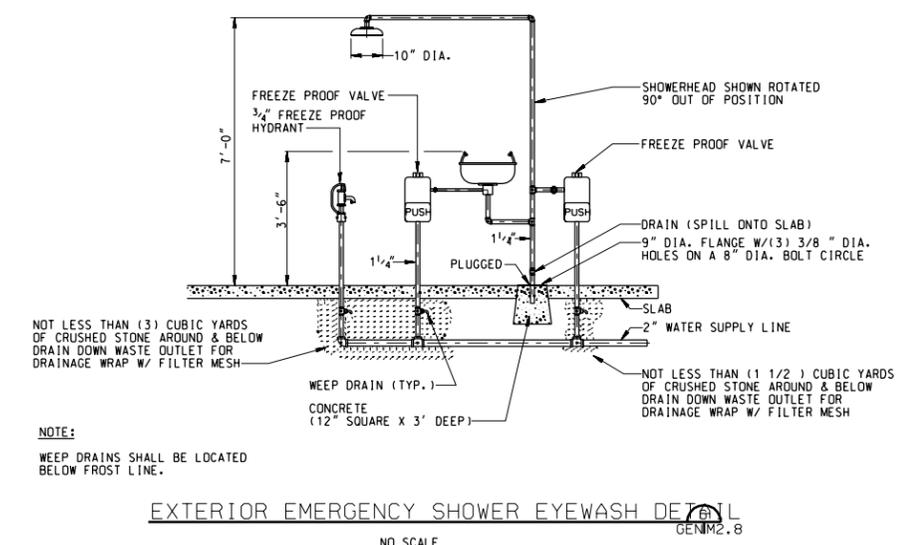
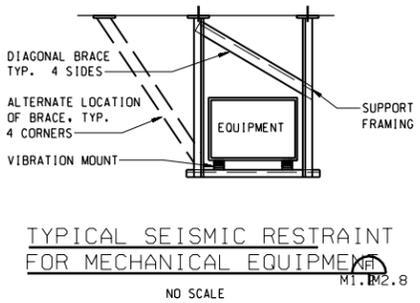





NOTE:
ON FILTER SEPARATORS, DELETE BALL VALVES

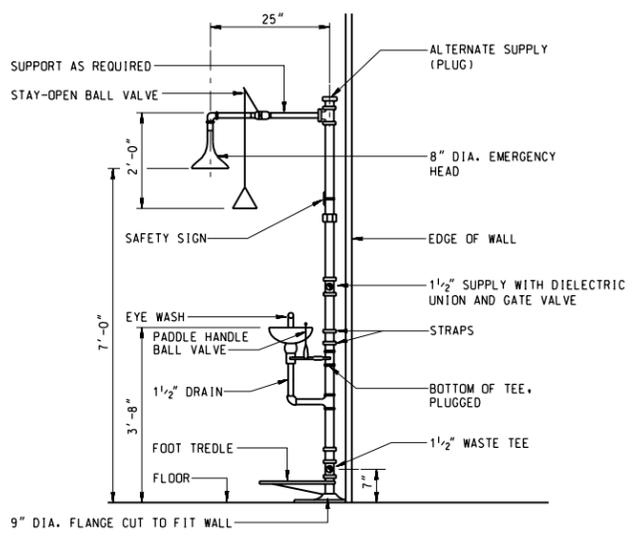

NOTE:
WEEP DRAINS SHALL BE LOCATED BELOW FROST LINE.

NOTE TO DESIGNER:
RECOMMENDED SHOWER AND EYEWASH IN UNHEATED PUMP SHELTERS WHERE FREEZING COULD OCCUR.

NOTE TO THE DESIGNER:
AFOSH STD 127-32 RECOMMENDS WATER TO AN EYEWASH TO BE 60-100°F. WATER TEMPERING MAYBE NECESSARY PER COMMAND FUEL FACILITIES ENGINEER

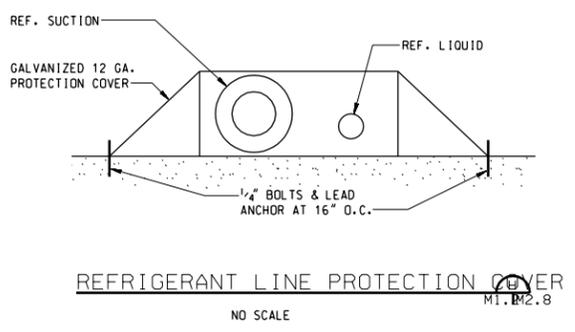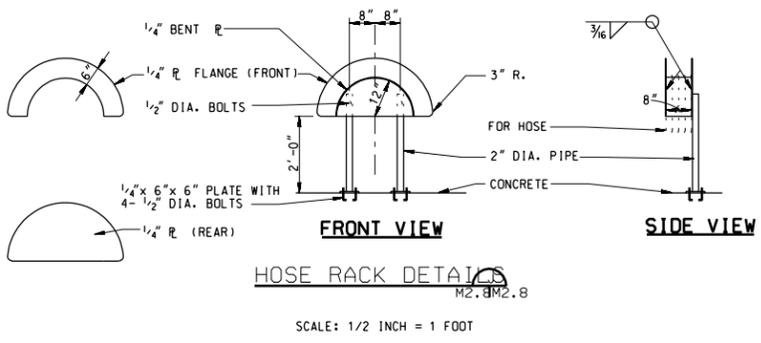

REVISIONS			
SYMBOL	DESCRIPTIONS	DATE	APPROVED

ROBERT AND COMPANY 96 POPLAR ST., N.W. ATLANTA, GA 30335	US ARMY ENGINEER DISTRICT CORPS OF ENGINEERS DANNA, NE	AIR FORCE C.E. SUPPORT AGENCY 139 BARNES DRIVE, SUITE #1 TYNDALL AFB, FL 32483-5314	
DESIGNED BY: J. J. P.	AIR FORCE STANDARDS PRESSURIZED HYDRANT FUELING SYSTEM TYPE III		
DRAWN BY: P. R. W.			
CHECKED BY: M. T. S.	DETAILS		
REVIEWED BY: S. G. E.			
SUBMITTED BY: CHIEF, MRCH. SECTION	PLOT SCALE RATIO: 2 : 1 DESIGN FILE: SD18M208.DGN SPEC. NO.:	DATE: REV. #1 NOV. 1998	SHEET REFERENCE NUMBER: M2.8
	78-24-28-88	AW 78-24-28	