CORPS OF ENGINEERS | 4 | 3 | 2 | 1 | U. S. ARMY

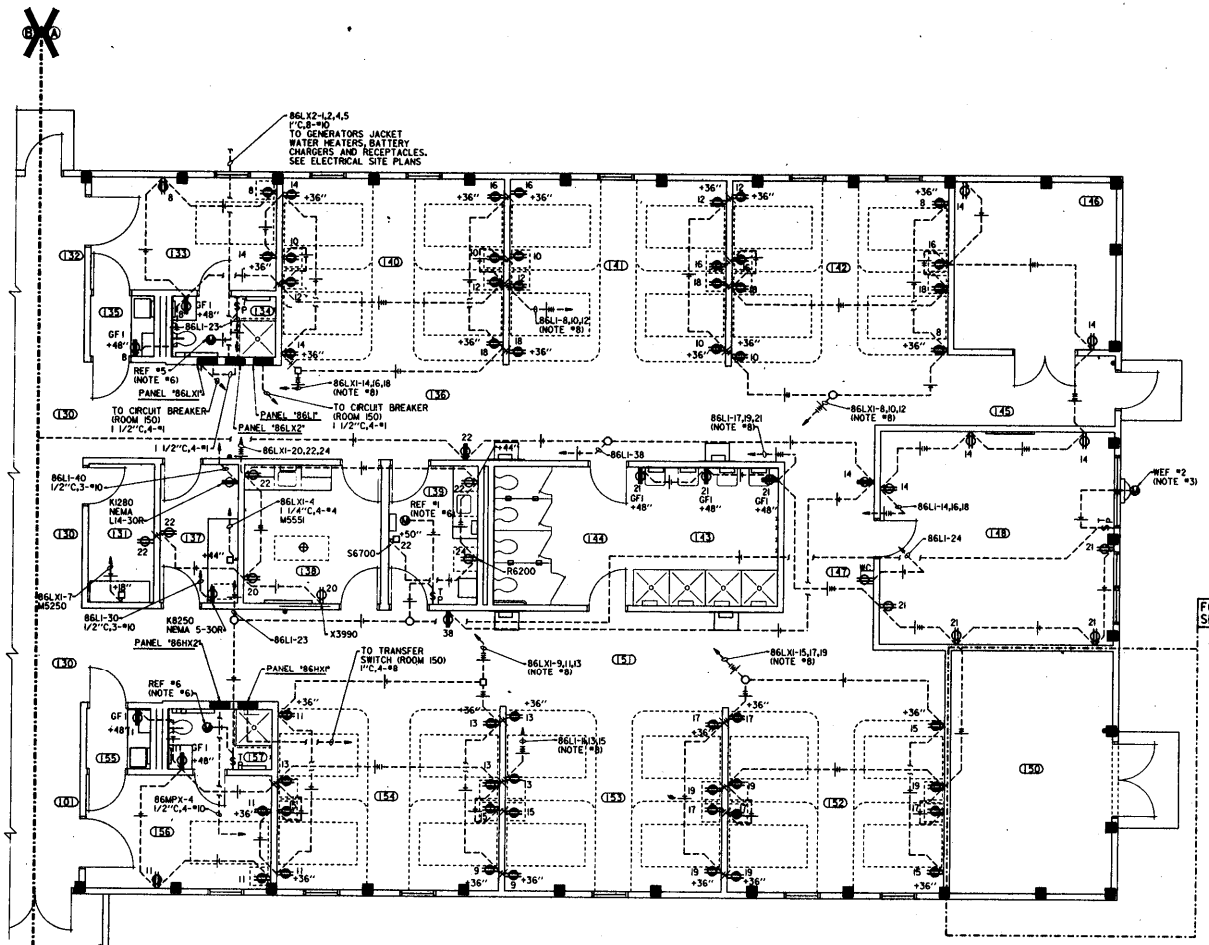

UNIT "A" POWER PLAN

1/4 INCH = 1 FOOT



KEY PLAN

PLAN NOTES:

1. ALL WIRING SHOWN SHALL BE 1/2" CONDUIT WITH #12 AWG WIRE AS INDICATED UNLESS OTHERWISE NOTED. ALL WIRE INSULATION SHALL BE RATED 75°C UNLESS OTHERWISE NOTED.
2. ALL RECEPTACLES SHALL BE MOUNTED AT +18" UNLESS OTHERWISE NOTED.
3. WEF FURNISHED WITH PREWIRED JUNCTION BOX AND DISCONNECT - SEE DETAIL ON XHVP SERIES SHEETS.
4. SEE G SERIES DRAWINGS FOR ELECTRICAL SYMBOL SCHEDULES, ABBREVIATIONS AND GENERAL NOTES.
5. ALL CLOCK OUTLETS SHALL BE MOUNTED AT +7'-0".
6. REF FURNISHED WITH PREWIRED JUNCTION BOX AND DISCONNECT - SEE DETAIL ON XHVP SERIES SHEETS.
7. SEE DRAWING E7 FOR RECEPTACLE LOCATIONS AROUND EACH PATIENT BED.
8. EACH RECEPTACLE SHALL HAVE ONE #12 INSULATED GROUND CONDUCTOR PER CIRCUIT CONNECTING TO EQUIPMENT GROUND. CONDUIT SIZE SHALL BE AS REQUIRED TO NOT EXCEED NATIONAL ELECTRICAL CODE CONDUIT FILL REQUIREMENTS.

ROOM NAME & NUMBER LIST

NO.	NAME
101	HALLWAY
130	HALLWAY
131	MEDICATION PREP ROOM
132	HALLWAY
133	ISOLATION BEDROOM
134	BATH
135	ANTEROOM
136	HALLWAY
137	NOURISHMENT ROOM
138	TREATMENT ROOM
139	SOILED UTILITY
140	4 BED WARD
141	4 BED WARD
142	4 BED WARD
143	LAVATORY/SHOWER
144	TOILET
145	HALLWAY
146	EQUIPMENT ROOM
147	HALLWAY
148	DAY ROOM
150	MECHANICAL
151	HALLWAY
152	4 BED WARD
153	4 BED WARD
154	4 BED WARD
155	ANTEROOM
156	ISOLATION BEDROOM
157	BATH

Symbol	Description	Date	Approved
	Revisions		

J. E. SIRRINE COMPANY
ARCHITECT - ENGINEER DIVISION
GREENVILLE, SOUTH CAROLINA

US ARMY ENGINEER DIVISION HUNTSVILLE
CORPS OF ENGINEERS
HUNTSVILLE, ALABAMA

Site adapt A/E :

ARMY MOBILIZATION DESIGNS
US Army Corps of Engineers

WARD - 46 BED

UNIT A POWER PLAN

Dwn. by : WLS	Ckd. by : JML		
Reviewed by : WHA	Date : 14 MAY 84	Sheet reference number : E-3	Design file no. : M086603 Rev.
Approved by : RSB	Drawing code : M 510-10-F		Sheet 3 of 11

1/4" = 1'-0" 4' 2' 0 4' 8'

5 | 4 | 3 | 2 | 1

T 15 D2