



MECHANICAL EQUIPMENT ROOM #150

1/2 INCH = 1 FOOT (ALTERNATE HIGH TEMPERATURE HOT WATER CENTRAL PLANT HEATING PLAN)

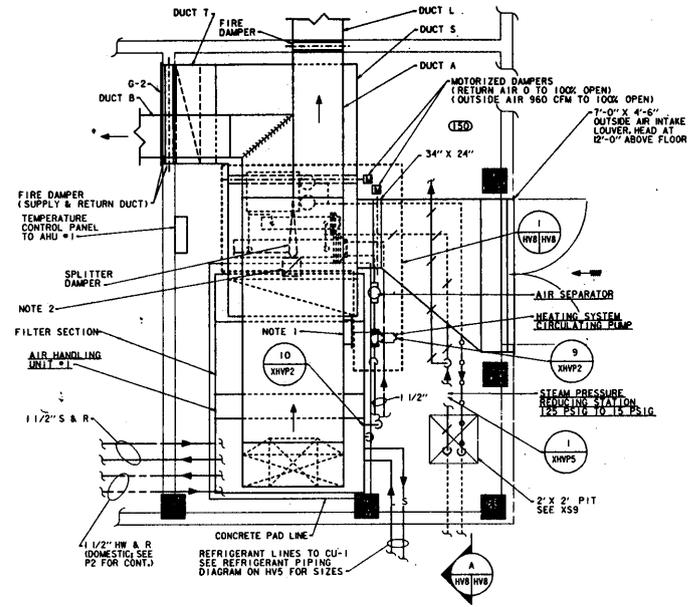

MECHANICAL EQUIPMENT ROOM #150


1/2 INCH = 1 FOOT (ALTERNATE STEAM CENTRAL PLANT HEATING PLAN)

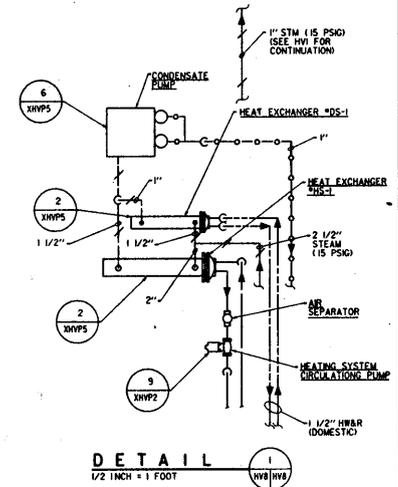


DETAIL
1/2 INCH = 1 FOOT

MECHANICAL EQUIPMENT ROOM #150 NOTES:

- 8" X 8" SUPPLY AIR REGISTER TO BE OPEN IN ZONES 3 AND 4 ONLY FOR FREEZE PROTECTION IN MECHANICAL ROOM.
- 8" X 8" RETURN AIR REGISTER TO BE OPEN IN ZONES 3 AND 4 ONLY.
- INSULATE ALL DUCTWORK IN MECHANICAL EQUIPMENT ROOM WITH 1 1/2 POUND DENSITY 1" THICK FOAM-BACKED FIBERGLASS INSULATION.
- SEE SHEET HV9 FOR PIPING DIAGRAMS AND MECHANICAL EQUIPMENT SCHEDULE.

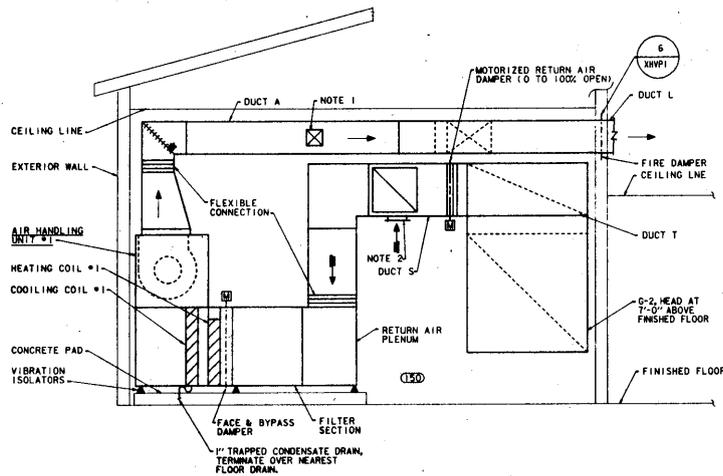

SECTION A-A
1/2 INCH = 1 FOOT

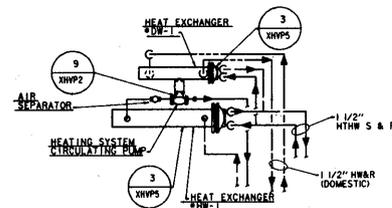

DETAIL
1/2 INCH = 1 FOOT

Symbol	Description	Date Approved
Revisions		
J.E. SIRRINE COMPANY ARCHITECT - ENGINEER DIVISION GREENVILLE, SOUTH CAROLINA		US ARMY ENGINEER DIVISION HUNTSVILLE CORPS OF ENGINEERS HUNTSVILLE, ALABAMA
Site adapt A/E: ARMY MOBILIZATION DESIGNS US Army Corps of Engineers		WARD-46 BED
Dwn. by: DLS	Ckd. by: JML	4 ALT MECH EQUIP ROOM PLAN
Reviewed by: MJC	Date: 14 MAY 84	Sheet reference number: 1
Approved by: CMH	Drawing code: M 510-10-F	Design file no.: M086408 Rev. 1
		HV-8 Sheet 8 of 10